


1

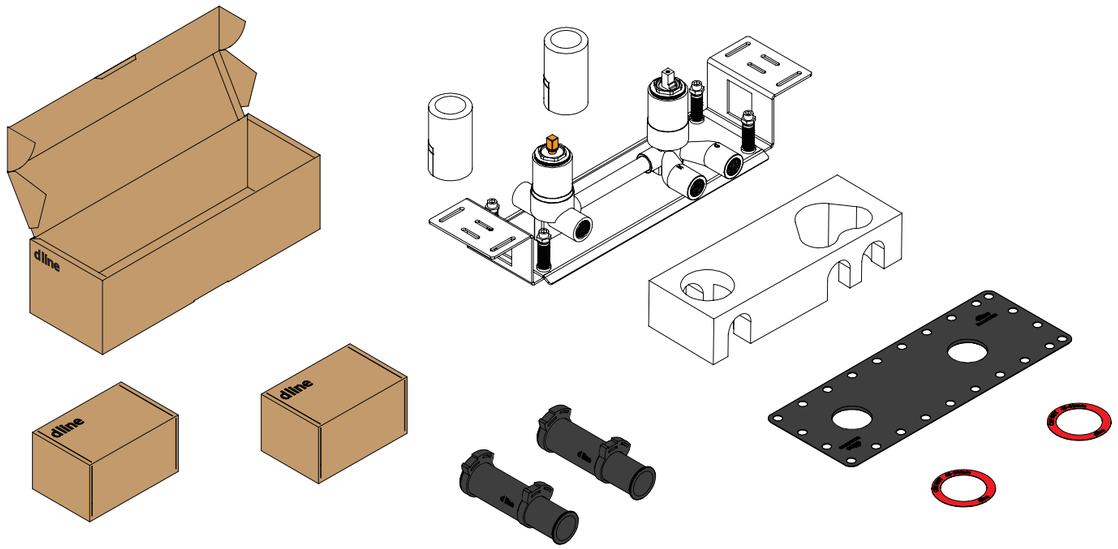


2

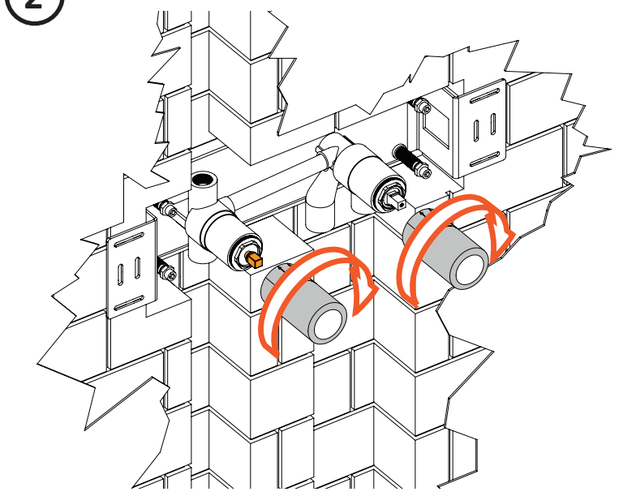


3

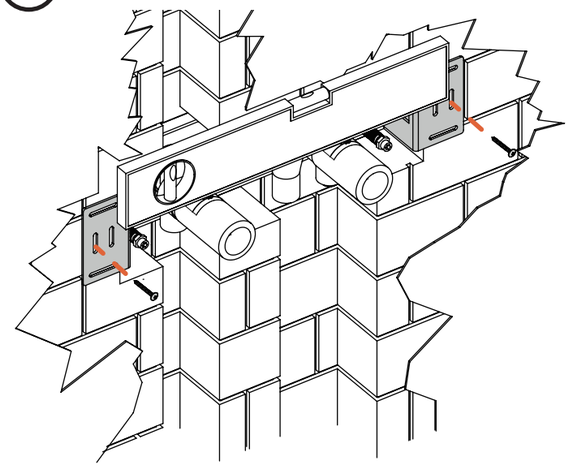


4

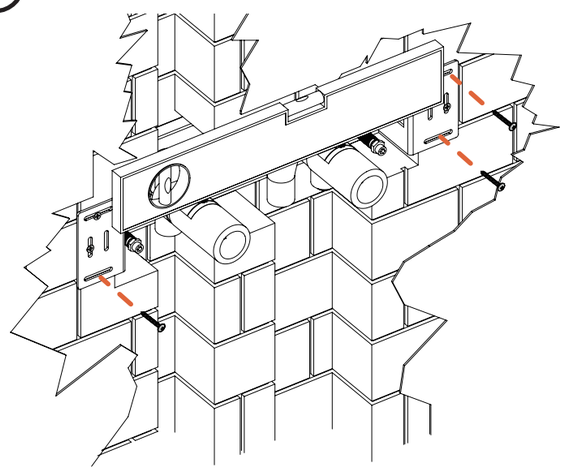


5

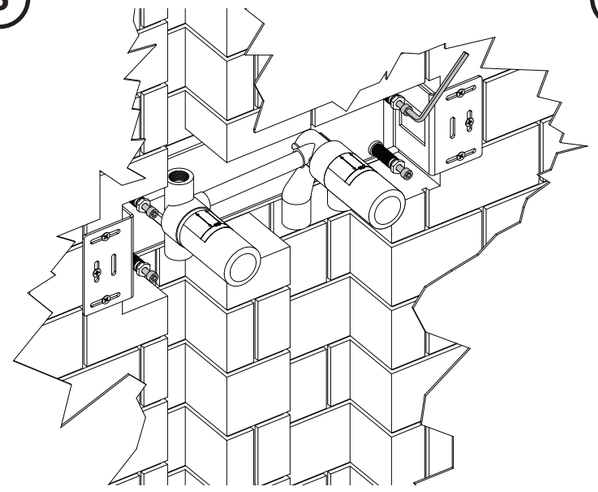


6

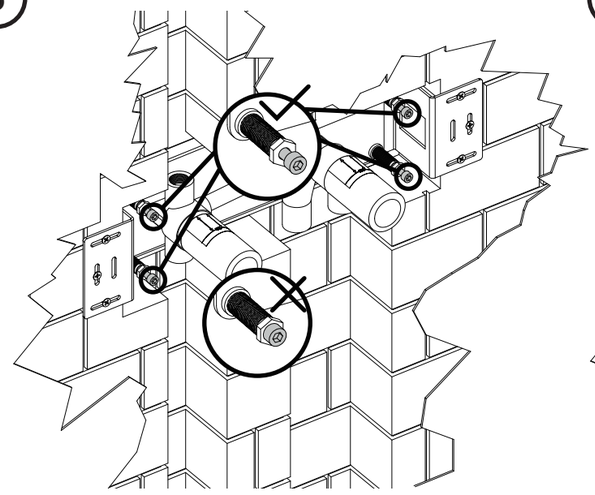


7

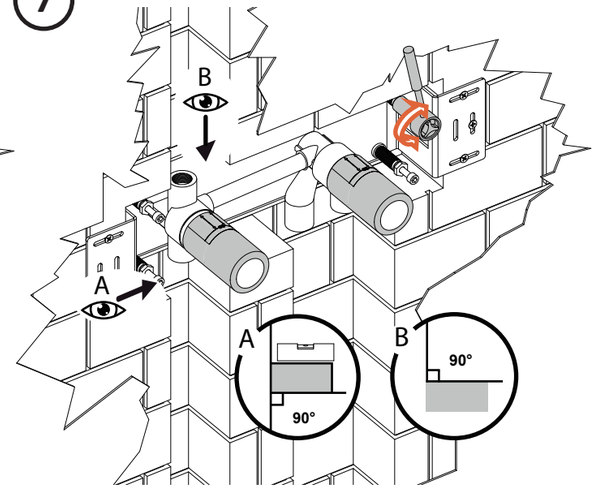


8

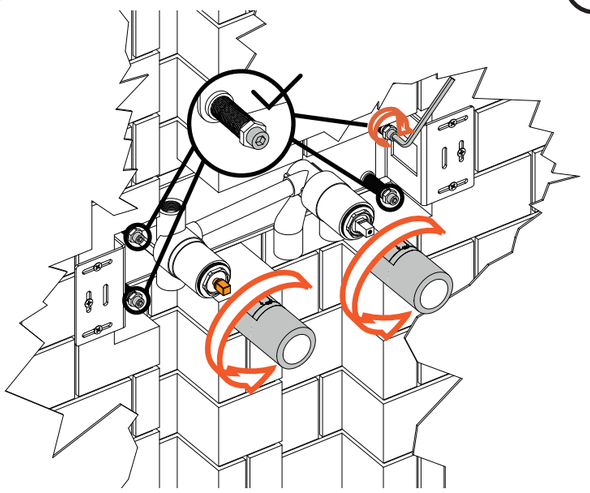


9

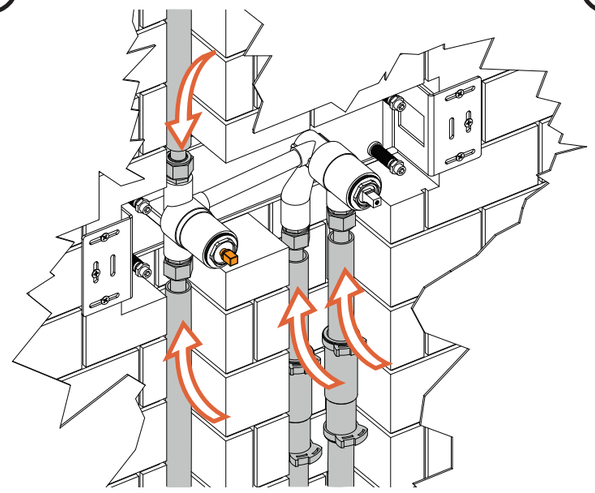

10

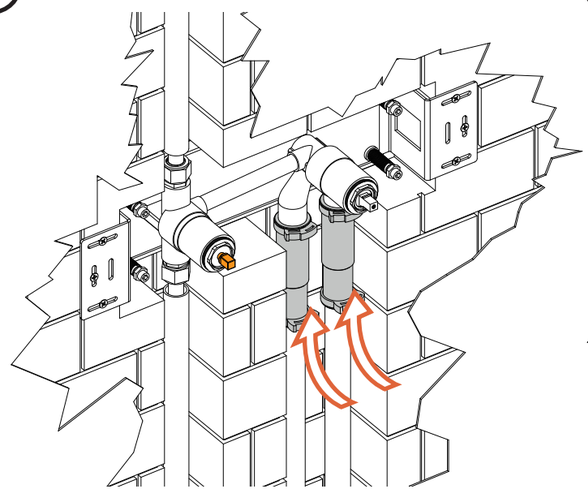


11

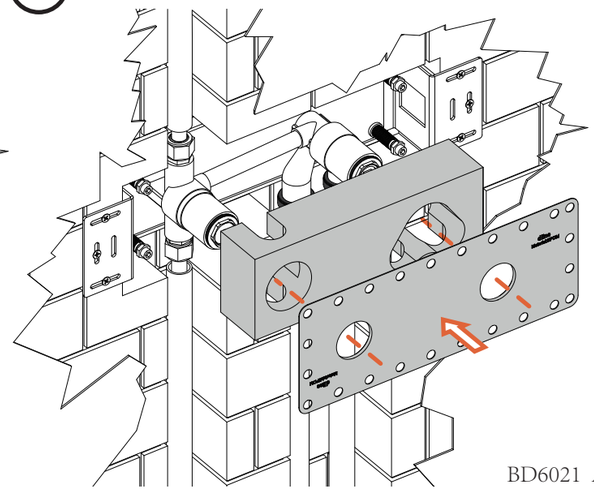


www.dline.com
BD6021 A5
2026.10.26

d line


12

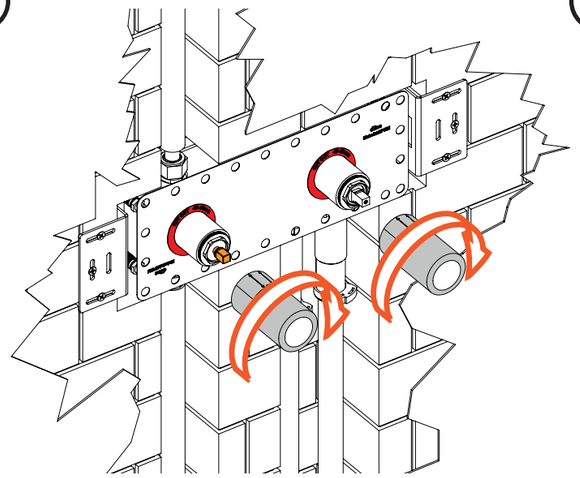


13

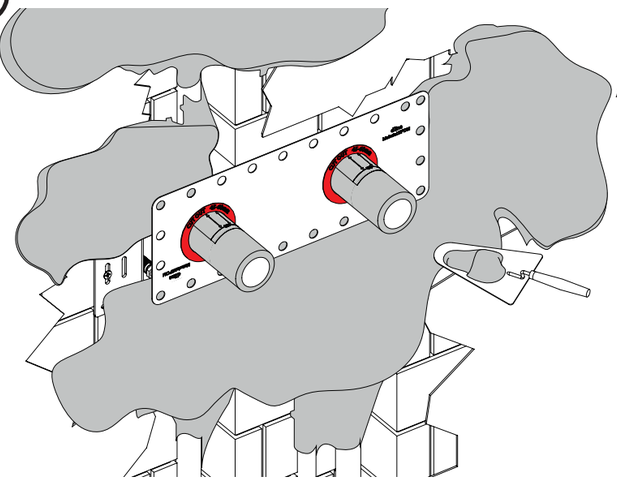



14

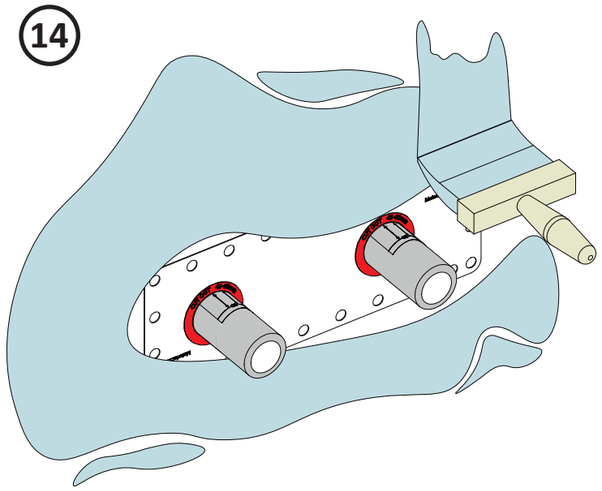

15

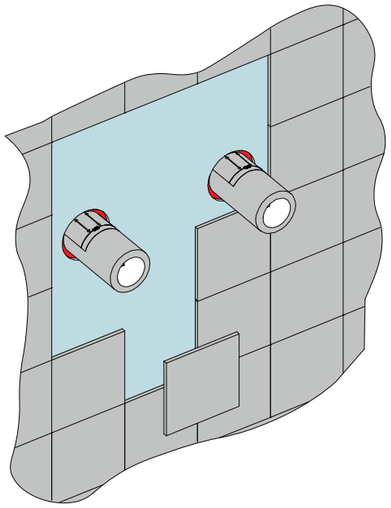

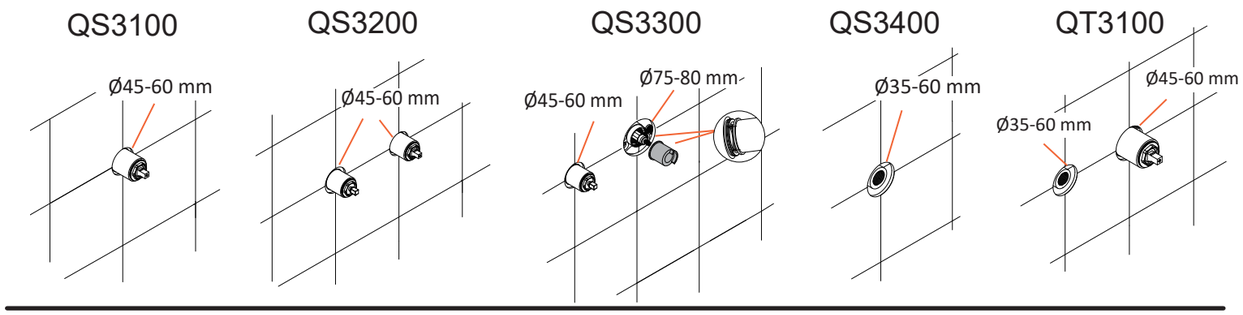


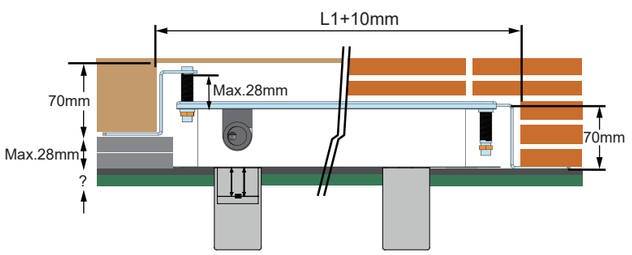


	L	L1	L2	L3	L4	L5	L6	H	H1
A	301mm	186mm	123.5mm	54mm	-	-	-	97mm	118.5mm
B	245mm	131mm	123mm	-	-	-	-		96.5mm
C	421mm	306mm	138.5mm	54mm	120mm	-	-	118mm	129mm
D	471mm	356mm	138.5mm	54mm	170mm	-	-		129mm
E	471mm	356mm	140.5mm	50mm	170mm	-	-		121mm
F	628.5mm	508.5mm	140.5mm	50mm	170mm	170mm	-		121mm
G	798.5mm	678.5mm	138.5mm	54mm	170mm	170mm	170mm		129mm

—Material : stainless steel 304 —1/2 " at water in/outlet


A（QS3100）

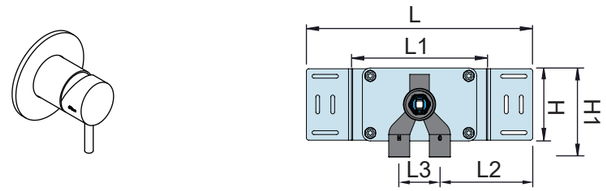


B（QS3400）

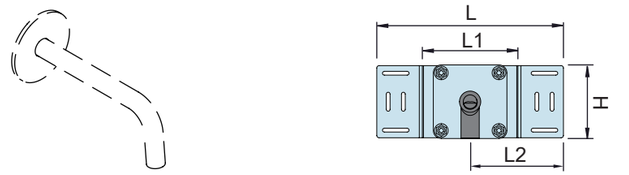


C（QT3100）

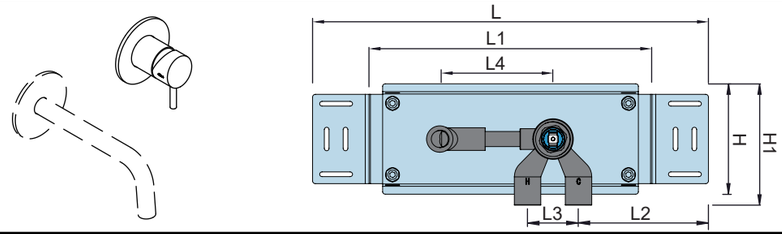


D（QS3200）

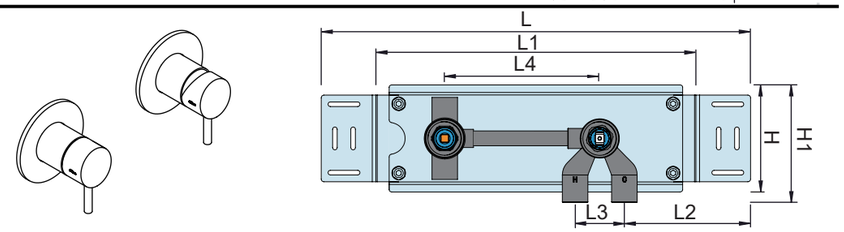


E（QS3300）

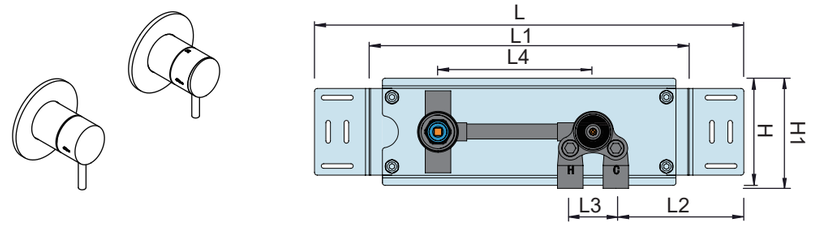

F（QS3300-340W）

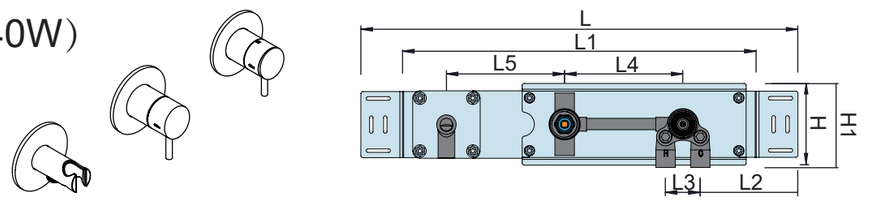

G（QS3200-190S）

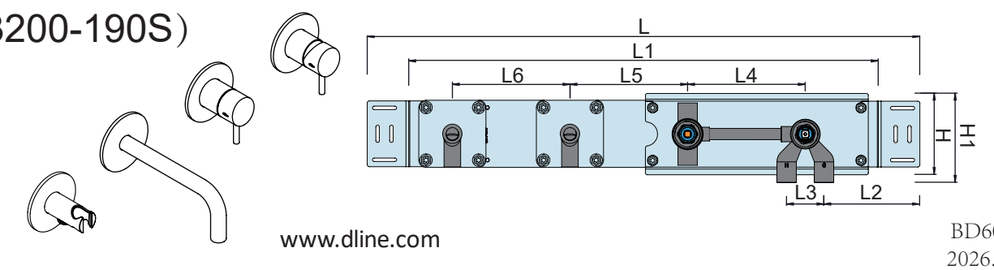


www.dline.com

BD6021 A5
2026.10.26


QS3300 INSTALLATION NOTE

d line

1

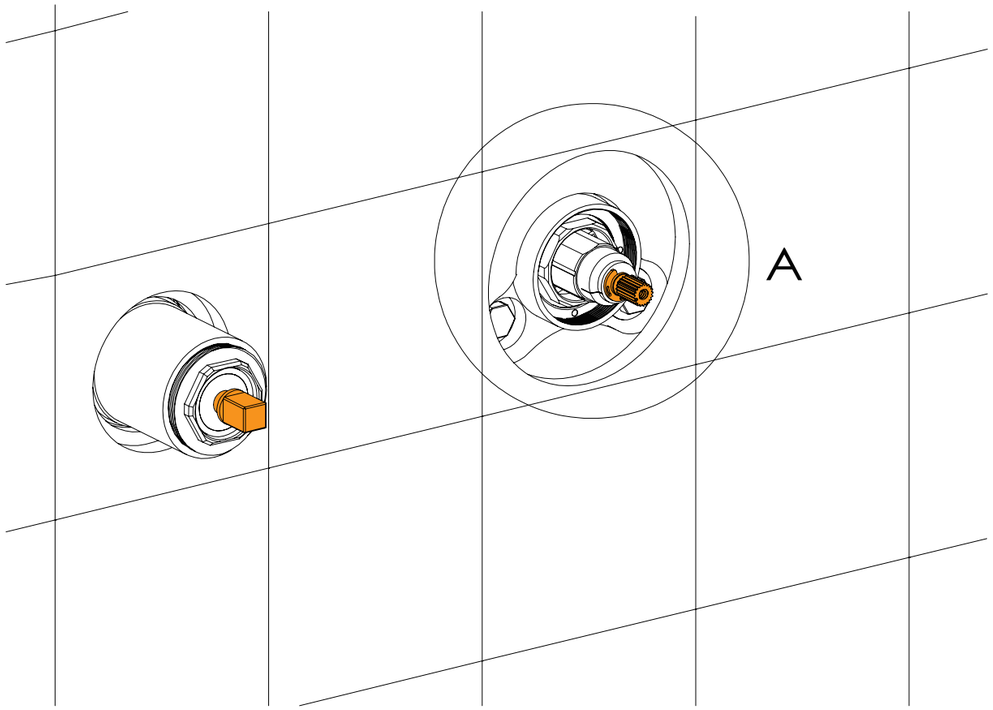


Detail A

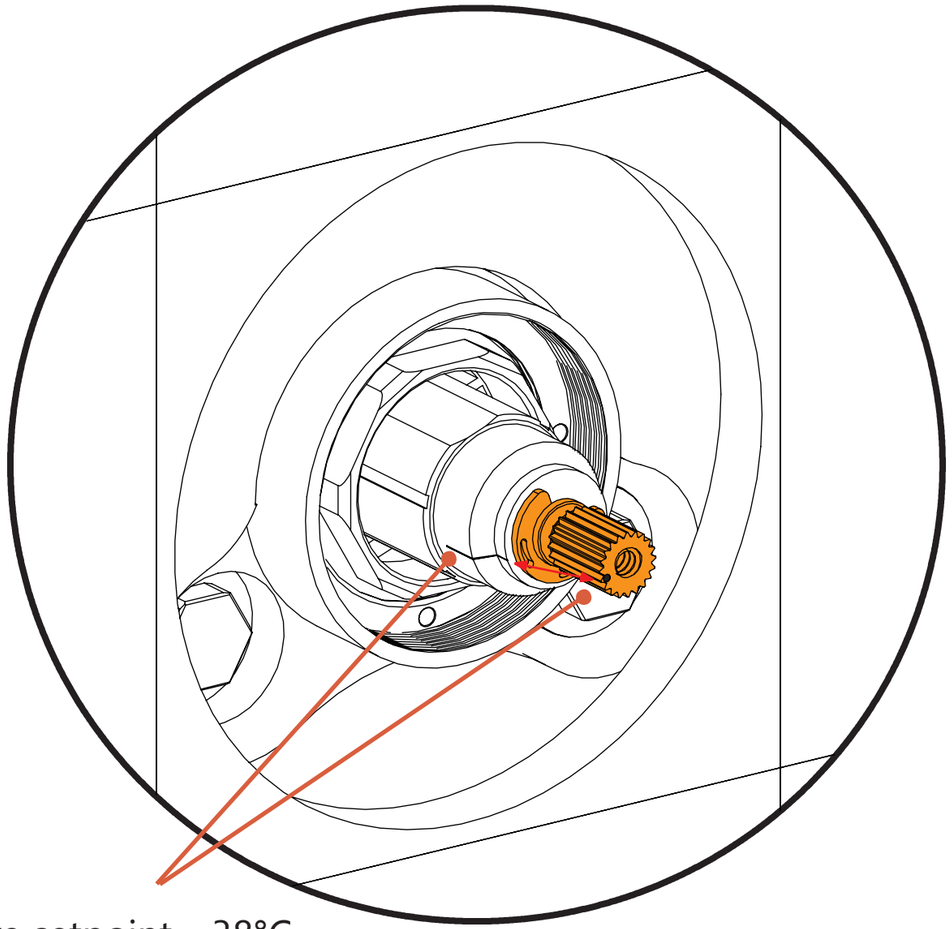

Temperature setpoint： 38°C

2

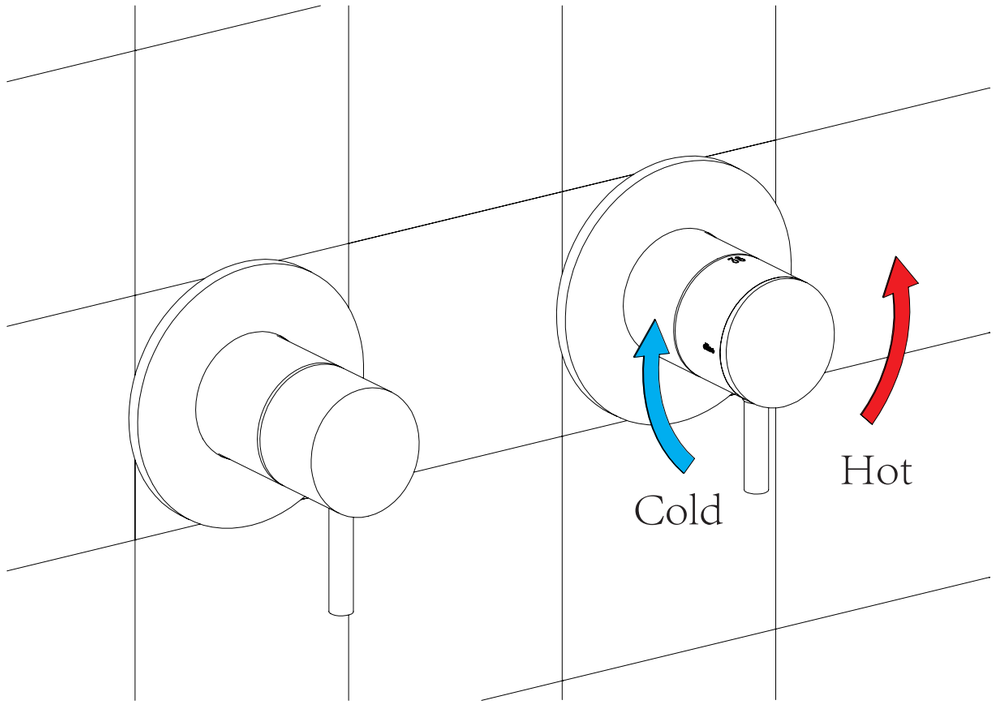

IMPORTANT: Separate isolation valves shall be fitted independently on both hot and cold inlet supplies, as close as practicable to the thermostatic mixing valve, and in an accessible location for commissioning, cartridge replacement and servicing. Isolation valves shall remain fully open during normal operation. Installation shall comply with local water supply regulations.

www.dline.com

BD6021 A5
2026.10.26